


HGM-IR(SZ)シングルゾーン用冷媒ガスモニターの設置例



HGM-IR(MZ)冷媒ガスモニター4入力用の設置例

- A Sample Inlet Pickup Point (for Halogen)
- B Outside Pickup Point Away from Refrigerant Gas (Fresh Air for MZ Purge Cycle)
- C Charcoal Filter (ONLY used with INDOOR pickup points).
- D Exhaust Air (to Outside)
- E HGM-MZ Multi Zone Gas Monitor
- F Remote Display (Outside Mechanical Room)
- G Exhaust Fan
- H Horn/Strobe Remote Alarm Outside Mechanical Room Door
- I 2nd Auxiliary Horn/Strobe Remote Alarm
- J Chiller

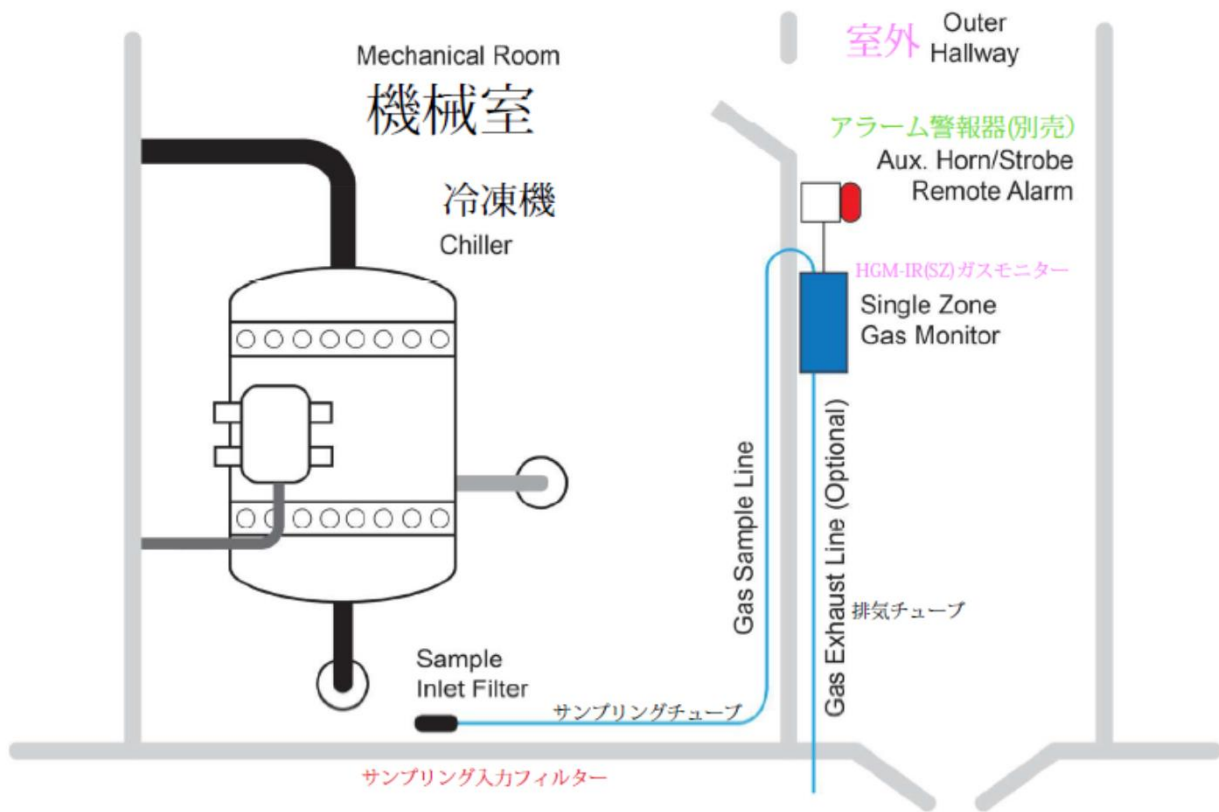